LDO

Infrastructure Study

Supporting Figure and Appendices



Study Area

APPENDICIES

A DŴR CYMRU / WELSH WATER SEWERAGE

B DŴR CYMRU / WELSH WATER - WATER SUPPLY


C WALES AND WEST GAS SUPPLY

D WESTERN POWER DISTRIBUTION ELECTRICITY SUPPLY


E BRITISH TELECOM


F VIRGIN MEDIA


A DŴR CYMRU / WELSH WATER SEWERAGE

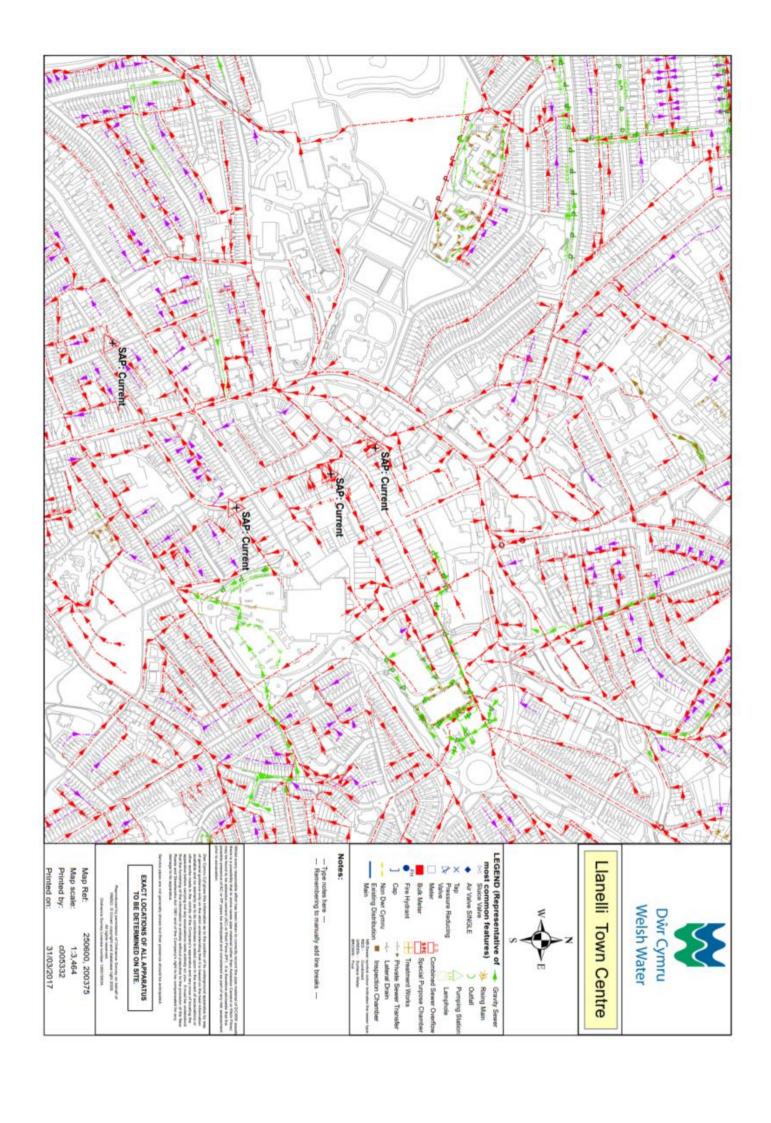


B DŴR CYMRU / WELSH WATER WATER SUPPLY

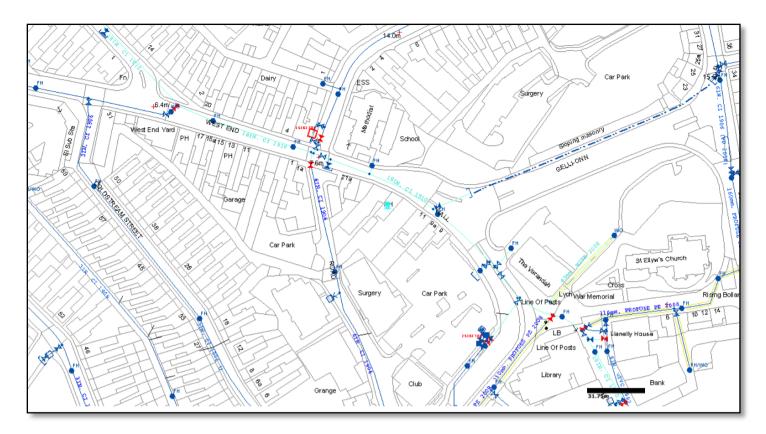


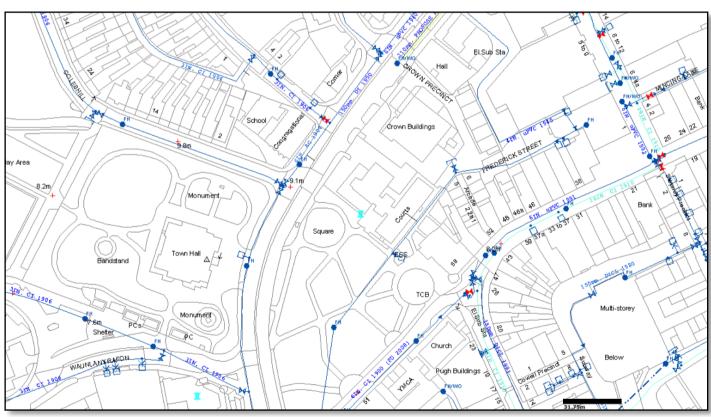


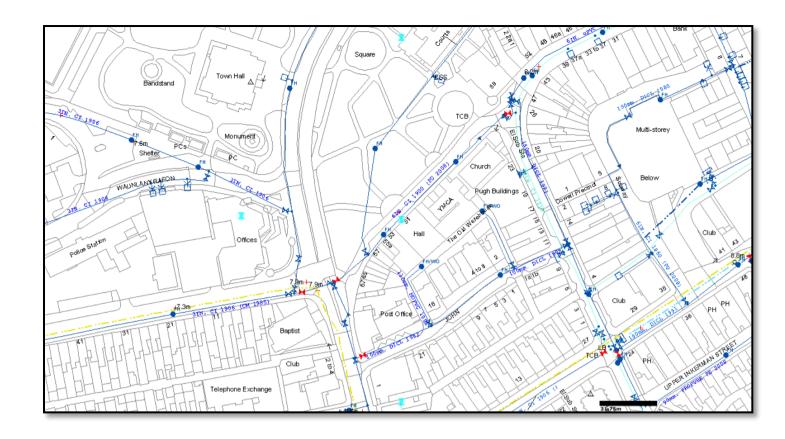


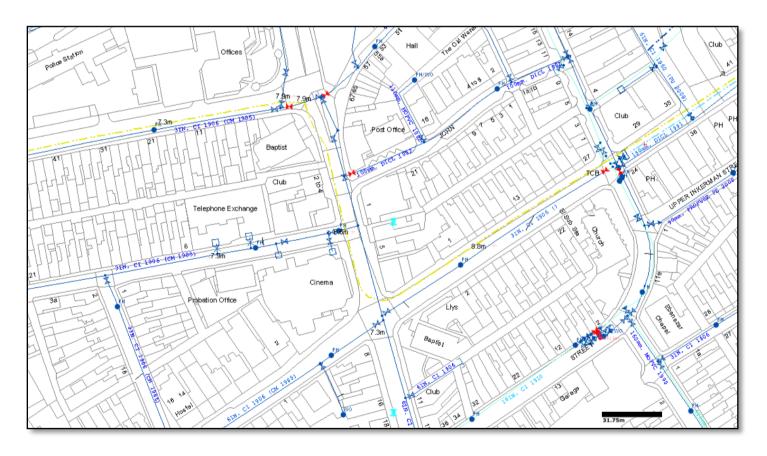





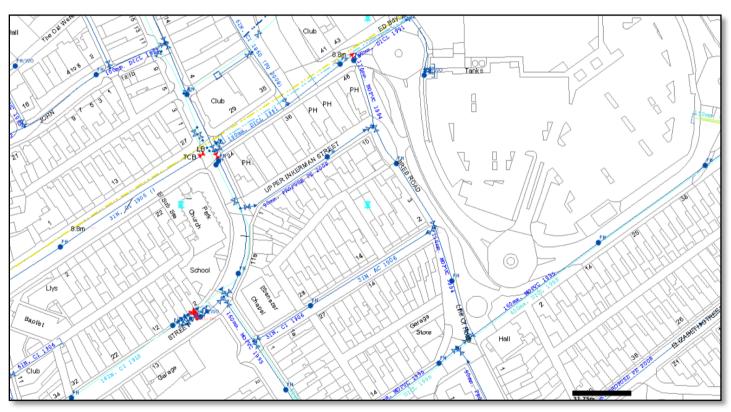


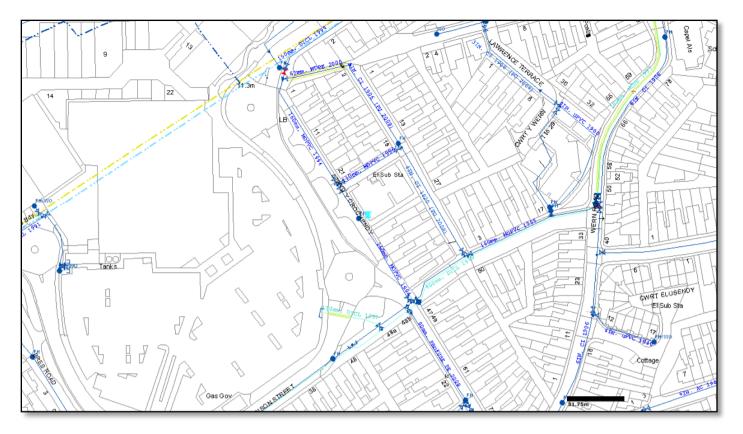


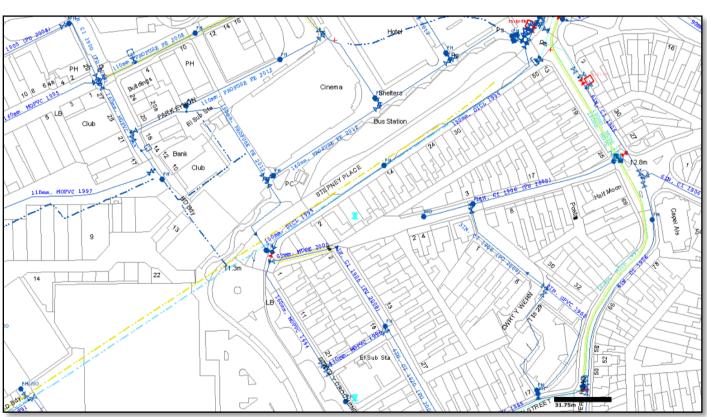


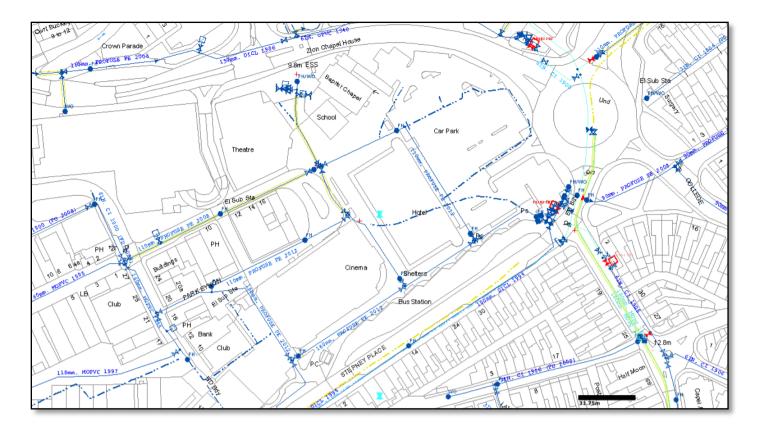

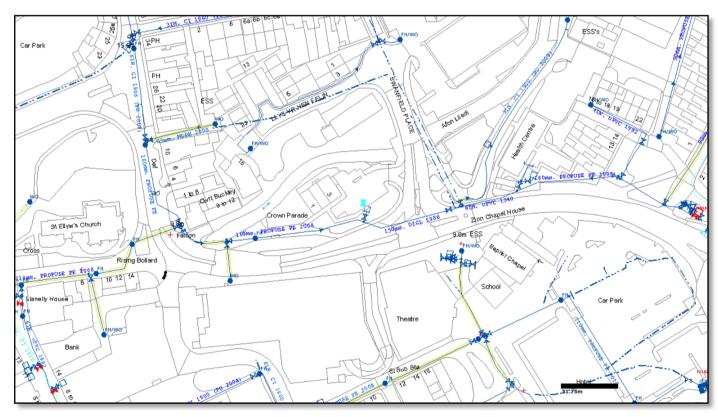


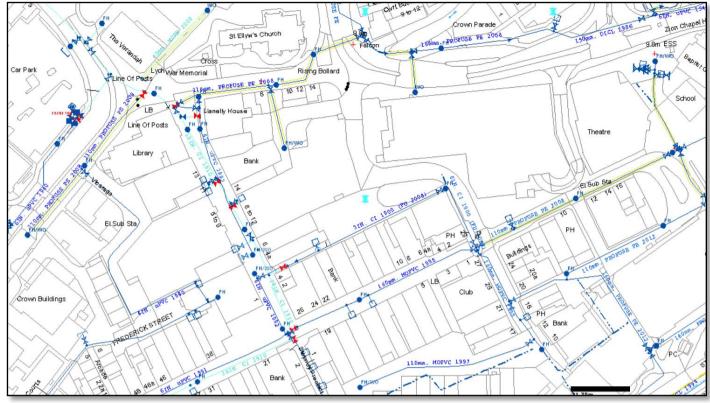


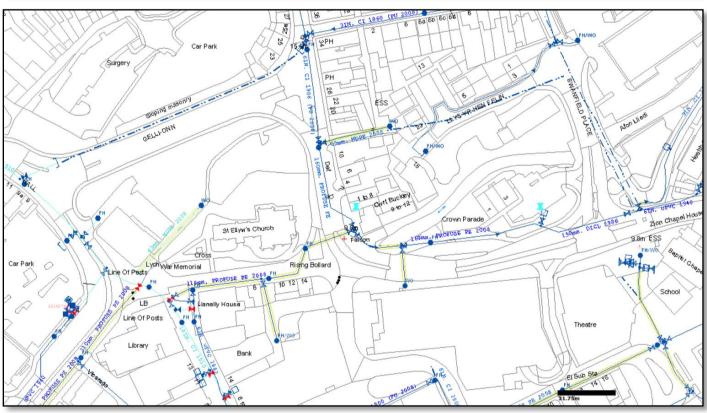


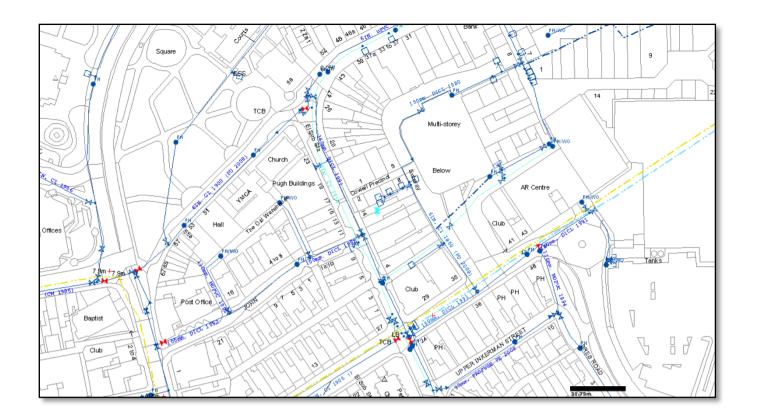



C WALES AND WEST GAS SUPPLY

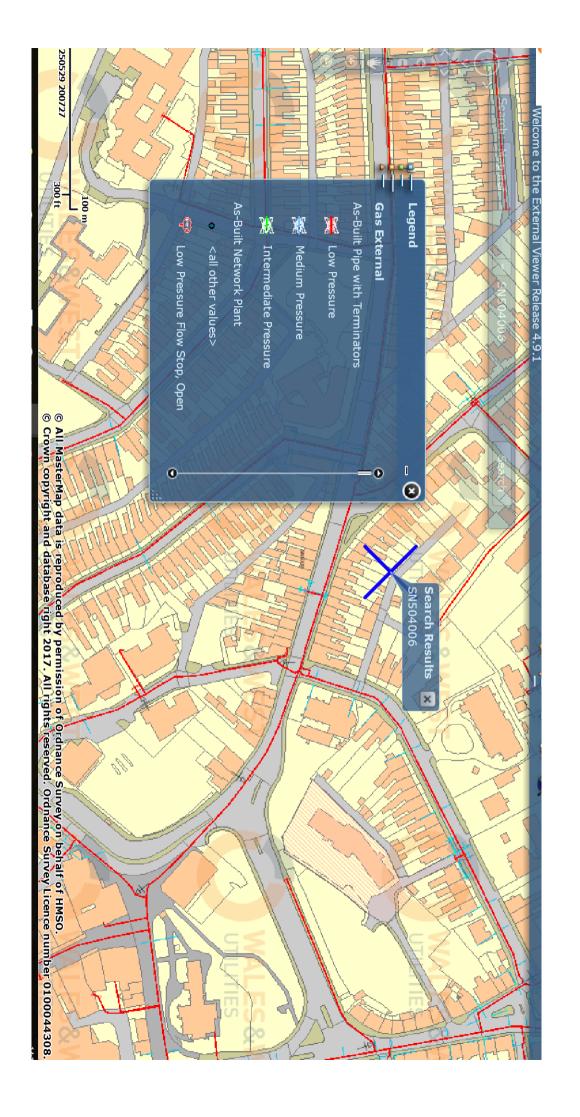


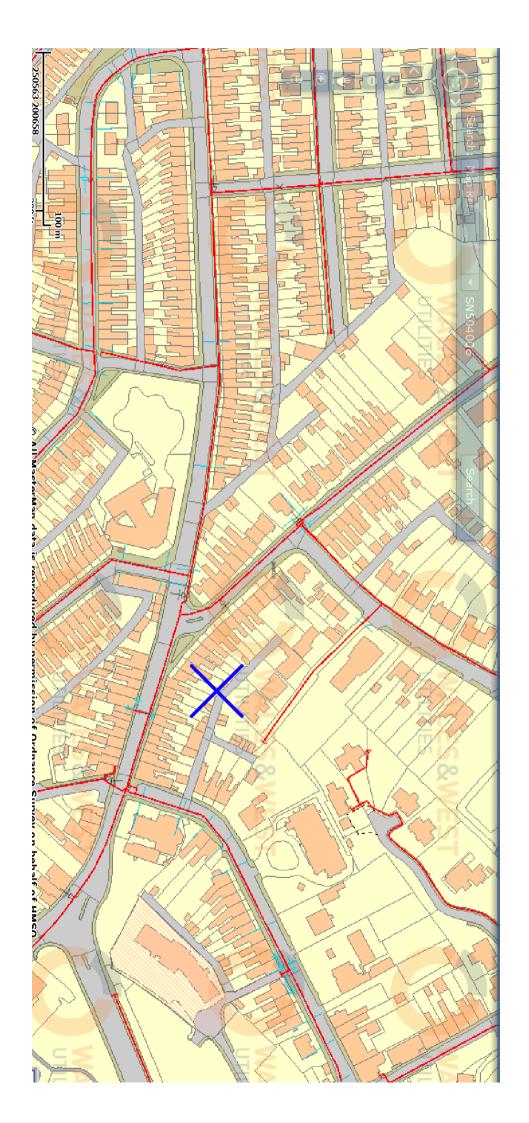


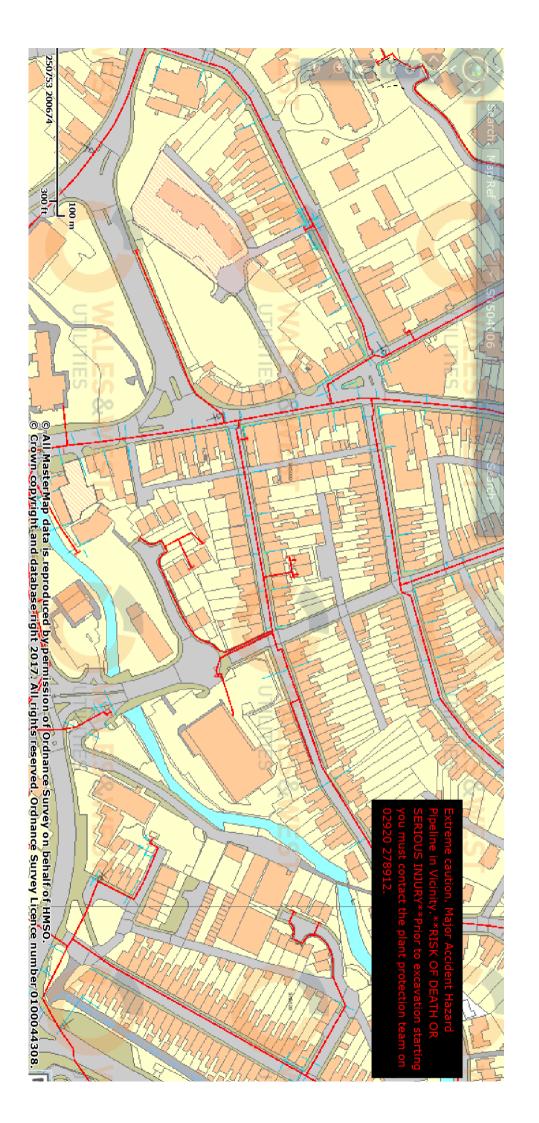


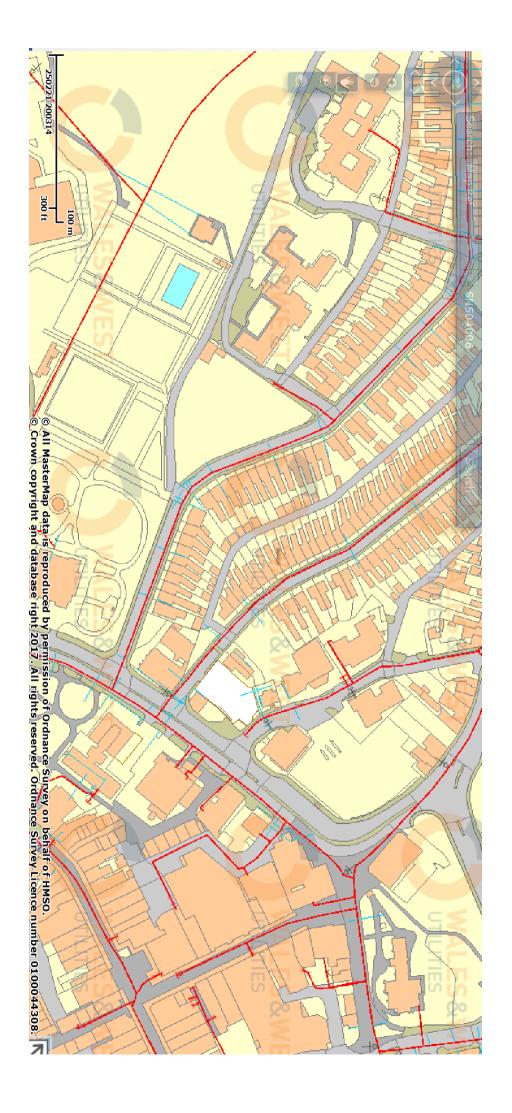


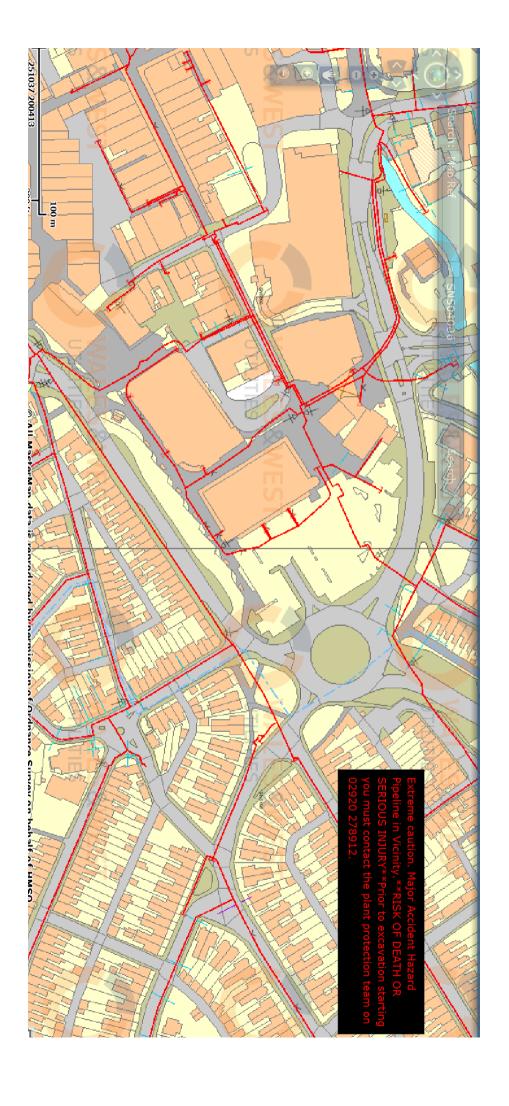

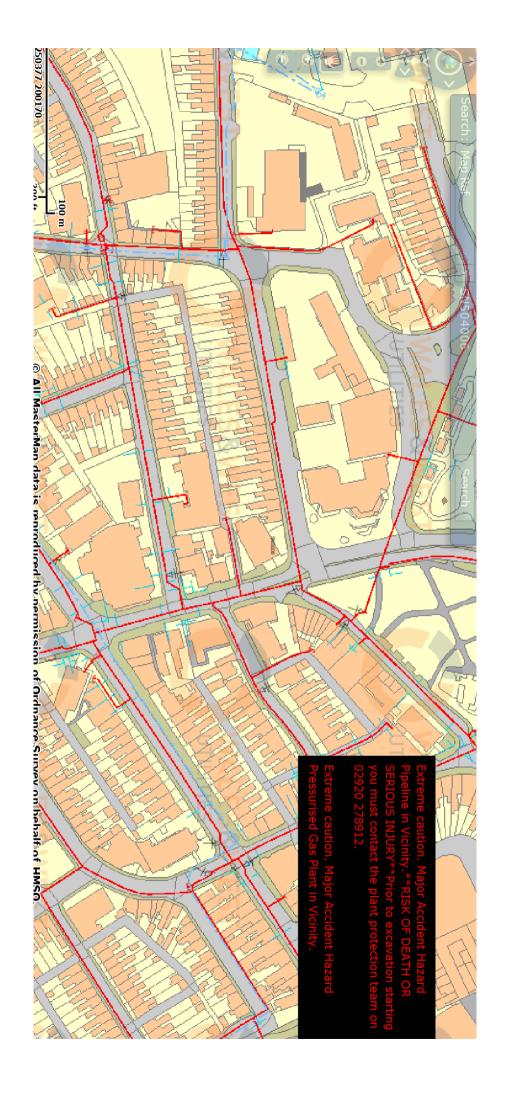


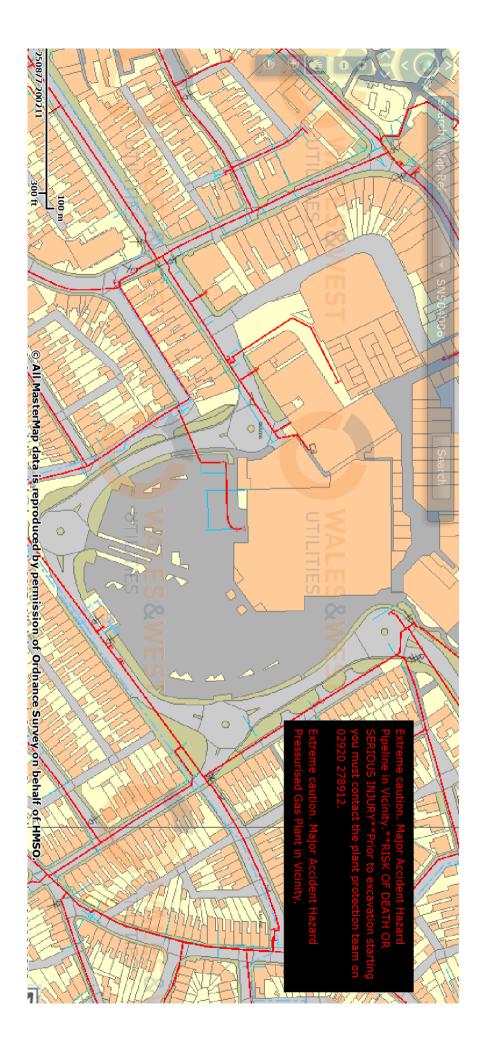

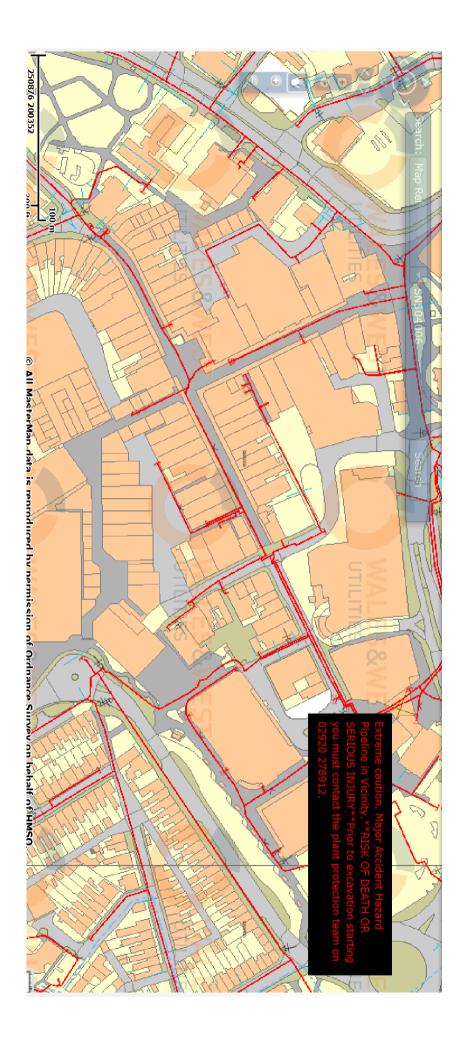

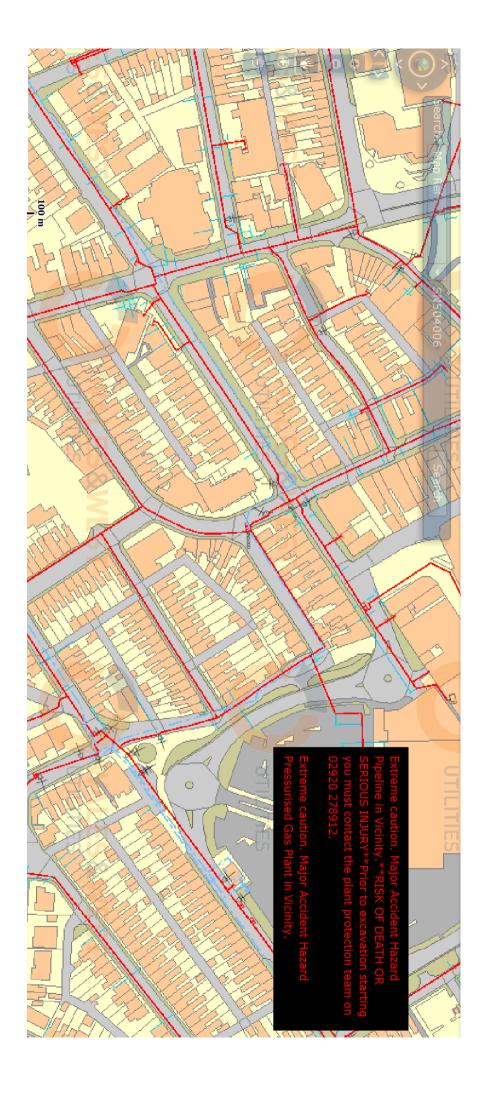

D WESTERN POWER DISTRIBUTION ELECTRICITY SUPPLY

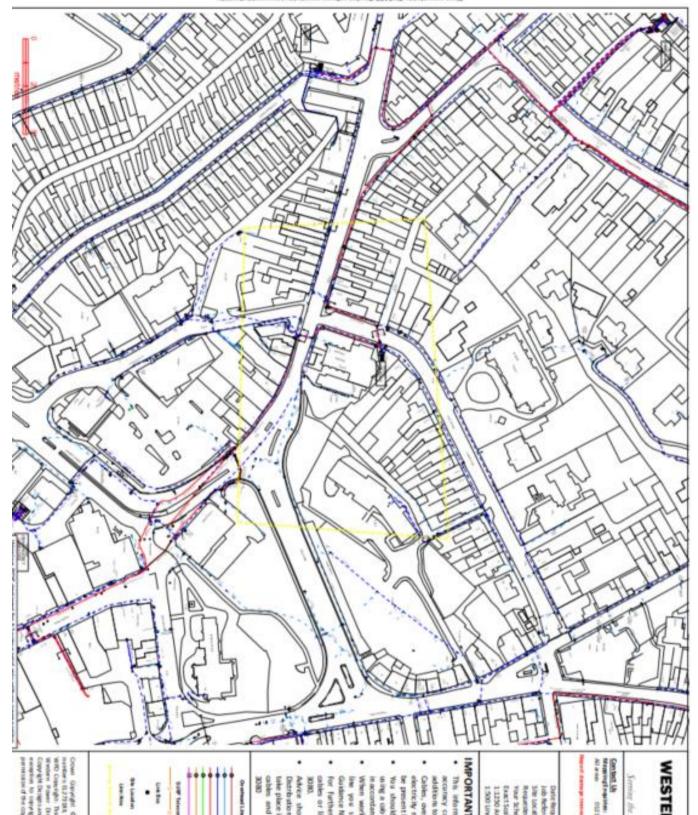

WESTERN POWER DISTRIBUTION

Service the Middlends, South Wast and Wales

OWLEDING

DD1 CR29 DD90

Sile Los atton: 250040300631 Requested by: AF Stant Fram: Your Scheme/Reference: Sanelli 10M

Job Reference: 3983331

(100/10/10 phperfoxe) and

Exact Sories:

aus lip and ooc t

1.1230 Area or Orde de site

WHEN SHE MEN CHOIC DIED CORD.

IMPORTANT NOTICES This information is given as a additions to the network may not be shown. accuracy cannot be guaranteed. Services or recent guide only and its


Cables, overhead lites & substations owned by other

- You should always verify exact locations of cables be present but will not be shown. electricity network owners or private companies may using a cable locator and by careful use of hand took
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6. is accordance with HSE guidance note HSG-67.
- for further advice on working near our electricity cables or lines, call our Contact Centre on 0800-096

3080


Advice should be sought from the Western Power Distribution Contact Centre for any work that is to take place in proximity to 65kV or 132kV underground cables and 66kV 132kV overhead lines - 0800 096

3080



Cover Oppdigit G All Rights financed Ordered by we branch number 10.25 list, 2000,0007 and 20002 lists.

Verb Coveright, the copie has been made for a with the authority of Western Power Distriction (NPD) pursued to Section 41 of the Copyright Origin and Potenti Art 1886 and exhibit Art provide a microart employ to copy and Potenti Art 1886 and not be copied without the previous of the copyright owner.

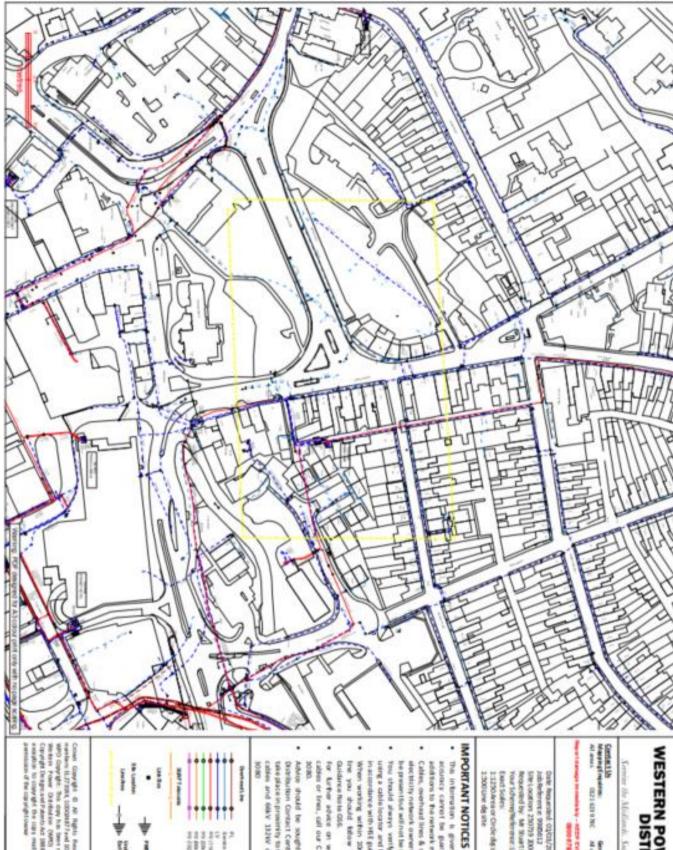

WESTERN POWER N POWER STRIBUTION

Seed Wist and Wido

Mapping repairs: All great 021 (21 07) C

Mann Allegaries

DRESEDRE

STATES CARD NOW

PROMETER AREA

1:1200 Area or Orde dig ste 1:200 Unit dig ste

(Wid Soles)


Size Location 230729 200629 Requested by: Ne Stuart Evens Your Schemigflichmence stavelli

Job Reference 9905612 Date Requested: 01/01/2017

The information is given as a guide only and its accuracy carvot be guaranteed. Services or recent additions to the restwork may not be shown.


Cables, averhead lines & substations awned by other

- You should always verify exact locations of cables in accordance with HSE guidance note HSG&7. using a cable locator and by careful use of hand tools he presentitut will not be shown. electricity network owners or private companies may
- for further advice on working near our electricity cubbes or from, call our Contact Contre on 0800 086 When working within 30m of any overhead electric line you should bllow the requirements of HSR Guidance Rote GSS.
- 1080 Advice should be sought from the Western Rower Stateburton Contact Centre for any work that is to take place in premierably to fisher or 13.94 underground caldes and disky 13.2W ownhead lines; - 0000 006



Coast Capaget © All Rights Reserved. Orderate: Survey Lisense seathers (Littings, (2004)87) and (2002)897.

WHO Capaget Site or capt has been made by or with the authority of the testing House Orderates (APO) parasite to testings of the Capaget Site (agencial Energy and Patients Act (2014 sets) to Capaget authority of the capaget of t

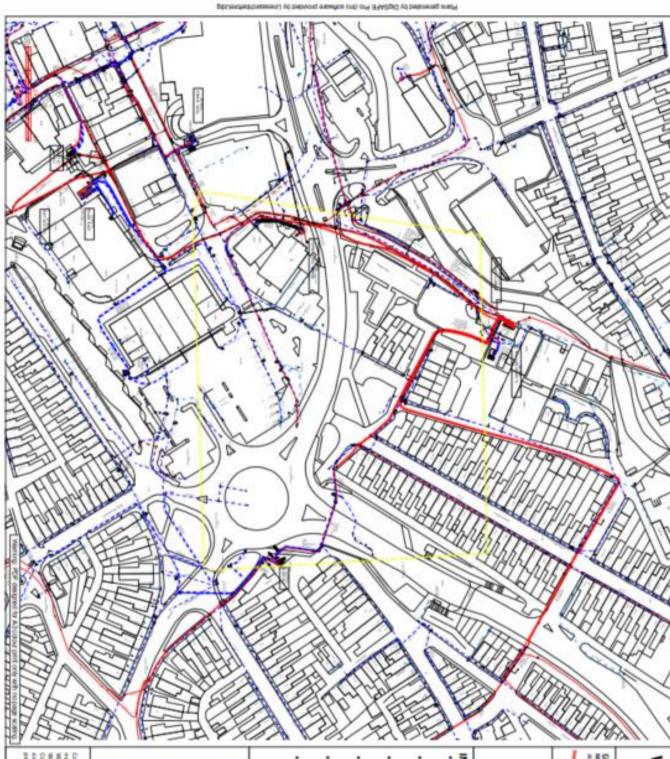

WESTERN POWER DISTRIBUTION

the Middlewsk. South #317 and #740.

General Empirical

DECHEDE

GROSSING TO ANALYSISM THE AREA GROSSING TO

Daid Sales Requested by Mr Start Evens Your Schemofflebronce Usinetti Site Location 250997 200558 Costs Requested 01/03/2017 Job-Reference: 9985727 1300 Shirt of 1315 CITY OF CHICAGO CONTRACTOR CONTRA

IMPORTANT NOTICES


- Cables, overhead lines & substations owned by other This information is given as a guide only and its additions to the network may not be shown. acturatly cannot be guaranteed. Services or recent
- You should always verify exact locators of cables using a cable locator and by careful use of hand tools be present but will not be shown electricity network owners or private companies may
- for further advice on working near our alsolvicity cables or lines, call our Contact Centre on 0800 096

When working within 10m of any overhead decisic line you should blow the requirements of HSE

in accordance with HEE guidance note HEGE7.

Guidance Note 056.

- Distribution Contact Centre for any work that is to take place in proximity to 66kV or 333kV underground cables and 66kV 333kV overhead lines = 0800 096. 0800 Advice should be sought from the Western Power



Court Capyget G. All Rights Reserved. Others Surrey Users eventures 0.77 (title), (2000) 37 (set) 50 et 2007; 2007. Wild Capyget, 1 the capy has been roade by the authority of the sen Fourier Christiania (MFC) pursuant to Section 40 of the Capyget Congruss of Familia and Sellin spikes that Adjacrades a relevant employe to capyget the copy and right to capyed without the prior personation of the capyget toward.



WESTERN POWER DISTRIBUTION

the Middende, Seath West and Wales

00214289780

DECTOR

DECEMBER AND ASSESSED ASSESSED. PROMETTY AREA

IMPORTANT NOTICES

1.1250-Area or Gride digiste 1.500 time digiste (wdt)des

the Location 20083 20049 Requested by Mr Stuart Evans Your SchemigReference stands

Job-Reference 9985979

This information is given as a guide only and its additions to the retwork may not be shown acouracy carrot be guaranteed. Services or recent


Cables, premised lines & substators owned by other

- You should always worth exact locations of cables be present but will not be shown electricity network owners or private companies may
- When working within 10m of any overhead electric line you should follow the requirements of HIX In accordance with HSE guidance note HGGET. using a cable locator and by careful use of hand tools

Guidance Note 056.

Sistibution Contact Centre for any work that is to sake place in presently to 664/r or 133kV underground cables and 684V 132kV overhead linus - 0800 096. for further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 Advice should be sought from the Western Rower

3080



Cover Cappyget © All Rights Reserved. Ordinance Survey Liamons mareholes (LTP IDEX, (SCICARE)* and LSDICATED).

"WHO Coppyget Sho copy has been made by or with the authority of Western Fower Classification (MPIC) purposed to Section 42" of the Copyright Shought and Reserved (MRI) purposed to Section of Howard Copyright Covery, and And the capput without the prior previous of the cappyget the capp and and the capput without the prior previous of the cappyget covery.



WESTERN POWER DISTRIBUTION

Middands, South Warf and Wate

385635120

ORCHODE.

GROUPS THE SHARE SHARE AND PRICE THE SHEET

IMPORTANT NOTICES

1.1250 Area or Circle dig site 1.500 Give dig site

Exect States:

Introcesor 20080 20077 Requested by Ar Start Cons Your Schemp/Reference Sands

Job Reference 398214 Date Requested: 0103/201


additions to the network may not be shown This information is given as a guide only and its acousty careot be guaranteed. Services or recent

Cables, overhead lines & substations owned by other

- using a cable locator and by careful use of hand tools You should always worly exact locations of cables be presenthat will not be shown electricity network owners or private companies may
- for further advice on working near our electricity cables or lines, call our Contact Centre on OSCO 096 Guidance Rote COE.


When working within 10n of any overhead deciric line you should follow the requirements of HTE in accordance with HSE guidance note HSG47.

Biardution Contact Carbre for any work that is to sale place in prominity to 6647 or 333Y underground calles and 664Y 333W owehead lines = 0800 096 3080 Advice should be sought from the Found



Count Capyget © All Rights Reserved. Ordering: Servey Lisense revertient (LT/TERX, CODQUEST) and 2000/2000?

990 Capyget, This copy has been reade by or with the auditority of theorem Fourie Charleston (NPC) provided to Service of of the Capyget Charges and Franch Lot 1988 and with discharate employee to copyget the copy must not be copied without the prior parentisate to copygight the copy must not be copied without the prior parentisate of the capyget country.

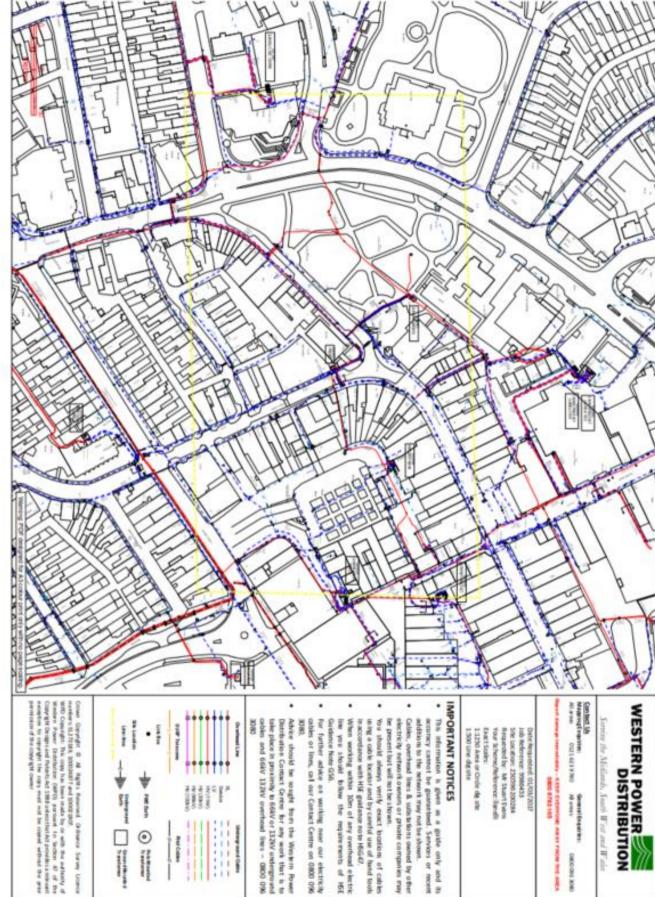

WESTERN POWER DISTRIBUTION

Service the Midlands, Snath West and Wales

- KEEP EVENTOR VALUE AND WHITE

Ad armet Enquiries

CBCK 140 CORD

Carlo Grand

0 Transferance of

Cross Cappight © All Rights Reserved. Officerce Survey Userial newhern (L. 7) (bit is, 2009)(ab)? and (2002)(ab)?.
WED Cappight This copy has been made by do with the subfacility of Windows Power Clastification (NPID) pursued to Section A? of the Cappight Chapps and PauloSed (Site autochiet Ad provide a advantage personal on deptyphy) the pays mad not be capped without the preservation of the cappight are pay mad not be capped without the preservation of the cappight are pays mad not be capped without the preservation of the cappight are pays.



WESTERN POWER DISTRIBUTION

ferring the Middands, South West and Walso

Contact Us Magainglingsision: All iron DC16214360 A seed to be seen in

380K 940 0080


ARRAY FIRE MEET VARIA

COLUMN DOS

IMPORTANT NOTICES


DATSON: 1300 tire de tite 1 1230 Ame or Orde de site

- Cables, overhead lites & substations owned by other This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- You should always verify exact locations of cables using a cable locator and by cereful use of hard took be present but will not be shown. in accordance with HSE guidance note HSG47. electricity network owners or private companies may
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 When working within 50m of any overhead electric line you should below the requirements of HEE Guidance Note GSG.
- Advice should be sought from the Western Power Butch size Contact Centre for any work that is to take place in proximity to 650 or 133Nv underground stake, and 66kV 132W overhead liters 0000 0x6



Court Oppright C. All Rights Received. Ordered Spreay Licenses reverses (32.75 px, 1000/ds)? and 1000/ds); WID Court St. This copy has less made by an with the surficety of Western Sharer Distriction (MRID personnel to Section 47 of the Copy (M. Cought and Sharesh Act 1886 and on the Act provides a selection copy (M. Cought and Sharesh Act 1886 and on the Act provides a selection exception to employed the copy ment not be copied without the prior permittation of the copy (M. Cower:

E BRITISH TELECOM

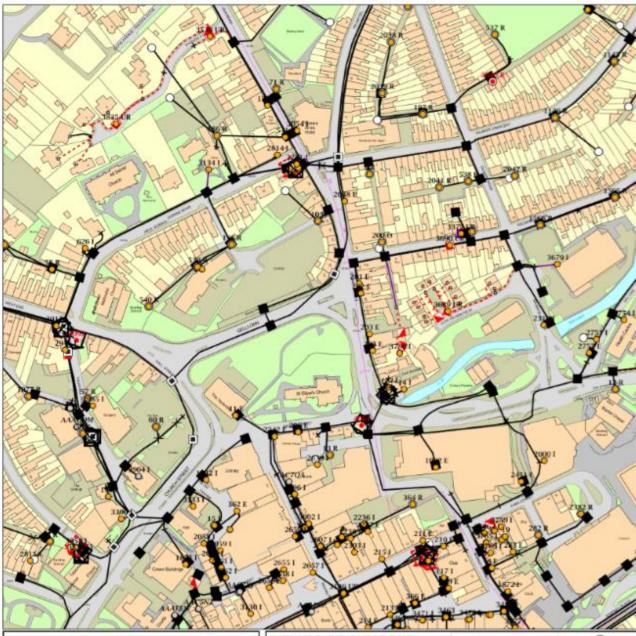

Information regerding the location of BT apparetus is given for your assistance and is intended for general guidance only. No guarantee is given of its accuracy. It should not be relied upon in the event of excavations or other works being made near to BT apparatus which may exist at various depths and may deviate from the marked route.



openreach

CLICK BEFORE YOU DIG

FOR PROFESSIONAL FREE ON SITE ASSISTANCE PRIOR TO COMMENCEMENT OF EXCAVATION WORKS INCLUDING LOCATE AND MARKING SEPURCE


email cbyd@openreach.co.uk

ADVANCE NOTICE REQUIRED (Office hours: Monday - Friday 08.00 to 17.00) www.openrbach.co.uk/cbyd

Reproduced from the Ordnance Survey map by BT by permission of Ordnance Survey on poblif of the Controller of Her Maiesty's Stational


KEY TO BT SYMBOLS	Pole	0
DP	Planned Pole	0
Planned DP	Joint Box	
PCP	Change Of State	+
Planned PCP	Split Coupling	×
Built	Duct Tee	•
Planned	Planned Box	
Inferred	Manhole	
Building	Planned Manhole	
Klosk	Cabinet	Û
Hatchings	Planned Cabinet	O
	met an annual attent in the second	and death and there

Other proposed pilent is shown using deched lines. 8T Symbols not listed above maybe disregarded. Existing BT Plant may not be recorded. information valid at time of preparation.



BT Ref : GPI09304G

Map Reference : (centre) SN5 07000060

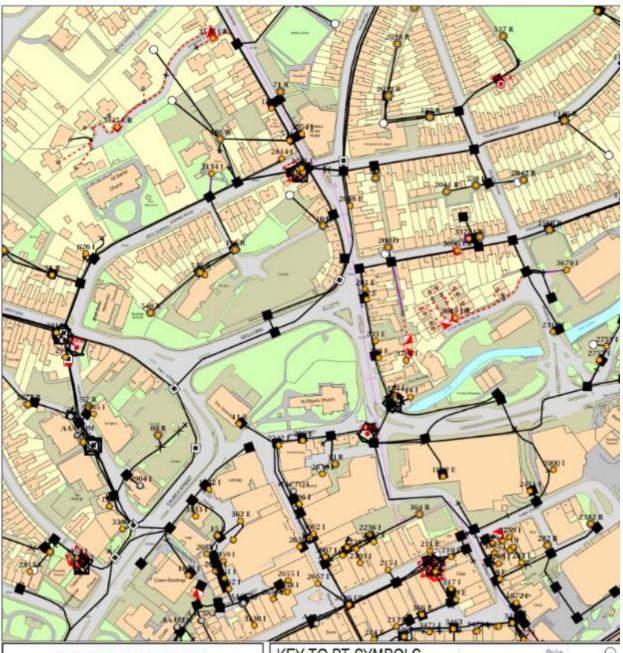

Information regarding the location of BT apparatus is given for your assistance and is intended for general guidance only. No guarantee is given of its accuracy. It should not be relied upon in the event of excavations or

It should not be relied upon in the event of excavations or other works being made near to BT apparatus which may exist at various depths and may deviate from the marked route.



openreach


CLICK BEFORE YOU DIG

OR PROFESSIONAL FREE ON SITE ASSISTANCE PRIOR TO COMMENCEMENT OF EXCAVATION WORKS INCLUDING LOCATE AND MARKING SERVICE

email cbyd@openreach.co.uk

ADVANCE NOTICE REQUIRED (Office hours: Monday - Friday 08.00 to 17.00) www.openreach.co.uk/cbyd

Reproduced from the Ordnance Survey map by BT by permission of Ordnance Survey on behalf of the Controller of Her Majesty's Stationery Office (C) Crown Copyright British Telecommunications of the

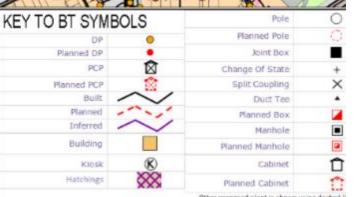


openread

Other proposed plent is shown using deshed it 8T Symbols not listed above maybe disregard Existing BT Plant may not be recorded. Information valid at time of oregaration

BT Ref : GPI09304G

Map Reference : (centre) SN50700 Easting/Northing : (centre) 25070 Issued : 27/03/2017 09:30:33

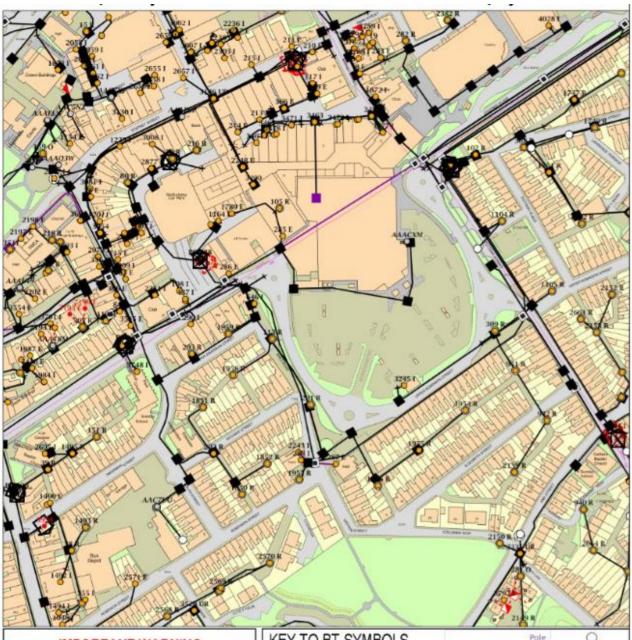

Information regarding the location of BT apparatus is given for your assistance and is intended for general guidance only. No guarantee is given of its accuracy.

It should not be relied upon in the event of excavations or other works being made near to BT apparatus which may exist at various depths and may deviate from the marked route



openreach

CLICK BEFORE YOU DIG

FOR PROFESSIONAL FREE ON SITE ASSISTANCE PRIOR TO COMMENCEMENT OF EXCAVATION WORKS TO COMMENCE AND MARKING SEPARCE

email cbyd@openreach.co.uk

ADVANCE NOTICE REQUIRED (Office hours: Monday - Friday 08.00 to 17.00) www.openreach.co.uk/cbyd


Reproduced from the Ordnance Survey map by BT by permission of Ordnance Survey on total of the Controller of Har Ministric Station

KEY TO BT SYM	BOLS	Pole	0
DP	0	Planned Pole	0
Planned DP	•	Joint Box	
PCP		Change Of State	+
Planned PCP	- 1	Split Coupling	×
Built	/	Duct Tee	•
Planned		Planned Box	
Inferred	~	Manhole	•
Building		Planned Manhole	
Klosk	(K)	Cabinet	Û
Hatchings	XXX	Planned Cabinet	0
		Other presented about to show and	no deshed lines

Other proposed plant is shown using deshed lines BT Symbols not listed above maybe disregarded. Existing BT Plant may not be recorded. Information valid at time of preparation

Onenreach BT Ref : ONH10539U

Map Reference : (centre) SN508000020

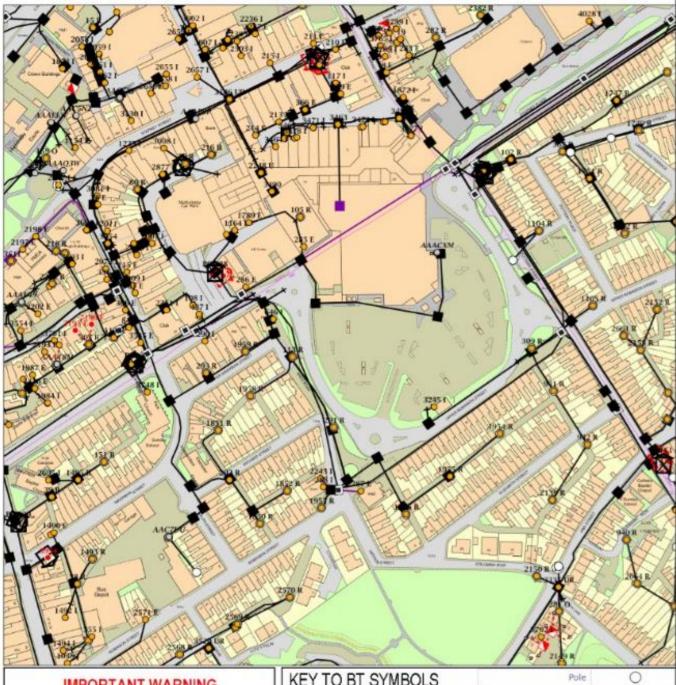

openread

IMPORTANT WARNING

Information regarding the location of BT apparatus is given for your assistance and is intended for general guidance only.

No guarantee is given of its accuracy.

It should not be relied upon in the event of excavations or other works being made near to BT apparatus which may exist at various depths and may deviate from the marked route.



openreach

CLICK BEFORE YOU DIG

email cbyd@openreach.co.uk

ADVANCE NOTICE REQUIRED (Office hours: Monday - Friday 08.00 to 17.00) www.openreach.co.uk/cbyd

Reproduced from the Ordnance Survey map by BT by permission of Ordnance Survey on Controller of Her Majesty's Station (C) Crown Coovright British Telecommunicati

		THE RESERVE THE PERSON NAMED IN COLUMN TWO IS NOT THE OWNER.	The state of the s
KEY TO BT SYME	BOLS	Pole	0
DP	0	Planned Pole	0
Planned DP	•	Joint Box	
PCP	Ø	Change Of State	+
Planned PCP	- 1	Split Coupling	×
Built	/	Duct Tee	•
Planned		Planned Box	
Inferred	/	Manhole	
Building		Planned Manhole	
Klosk	(K)	Cabinet	Û
Hatchings	XX	Planned Cabinet	Û
		Other proposed plant is shown in	one declared lines

Other proposed plant is shown using dashed lines BT Symbols not listed above maybe disregarded. Existing BT Plant may not be recorded. information valid at time of preparation

BT Ref: ONH10539U

Map Reference: (centre) SN508000020 Easting/Northing: (centre) 250800,200



Information regarding the location of BT apparatus is given for your assistance and is intended for general guidance only. No guarantee is given of its accuracy. It should not be relied upon in the event of excavations or

It should not be relied upon in the event of excavations or other works being made near to BT apparatus which may exist at various depths and may deviate from the marked route.



openreach

CLICK BEFORE YOU DIG

FOR PROFESSIONAL FREE ON SITE ASSISTANCE PRIOR TO COMMENCEMENT OF EXCAVATION WORKS INCLUDING LOCATE AND MARKING SERVICE

email cbyd@openreach.co.uk

ADVANCE NOTICE REQUIRED (Office hours: Monday - Friday 08.00 to 17.00) www.openreach.co.uk/cbyd

Reproduced from the Ordnence Survey map by BT by permission of Ordnence Survey on both of the Controller of Her Majesty's Stationer of the (C) Crown Coovright British Telecommunications

KEY TO BT SYM	BOLS	Pole	0
DP	0	Planned Pole	0
Planned DP	•	Joint Box	
PCP		Change Of State	+
Planned PCP	- 1	Split Coupling	×
Built	~	Duct Tee	•
Planned		Planned Box	
Inferred	~	Manhole	
Building		Planned Manhole	
Klosk	(K)	Cabinet	
Hatchings	XX	Planned Cabinet	Û
		Other proposed plent is shown using	ng deshed lines


openreac

Other proposed plent is shown using deshed lines BT Symbols not listed above maybe disregarded. Existing BT Plant may not be recorded. Information valid at time of preparation.

BT Ref: YLB10482F

Map Reference : (centre) SN5060000200 Easting/Northing : (centre) 250600,200

1-----

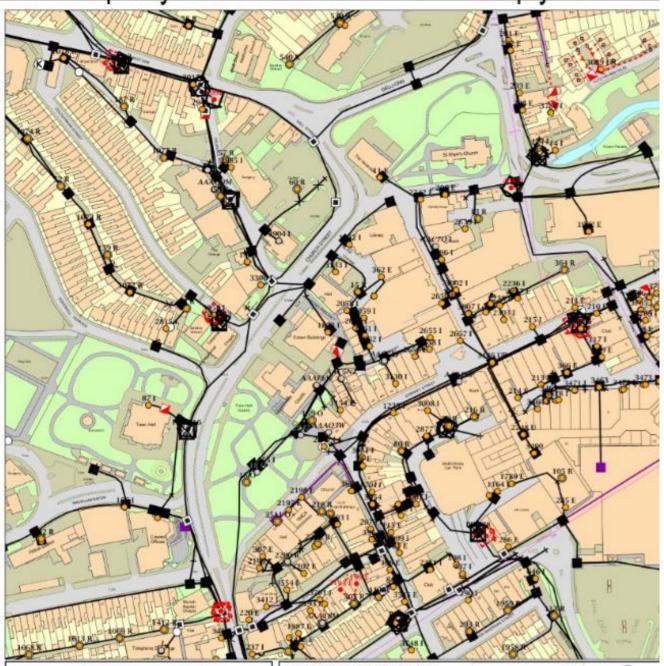

Information regarding the location of BT apparatus is given for your assistance and is intended for general guidance only. No guarantee is given of its accuracy.

It should not be relied upon in the event of excavations or other works being made near to BT apparatus which may exist at various depths and may deviate from the marked route.



openreach

CLICK BEFORE YOU DIG
PROFESSIONAL FREE ON SITE ASSISTANCE PRIOR
TO COMMENCEMENT OF EXCAVATION WORKS
INCLUDING LOCATE AND MARKING SERVICE

email cbyd@openreach.co.uk

ADVANCE NOTICE REQUIRED (Office hours: Monday - Finday 08.00 to 17.00) www.openreach.co.uk/cbyd

Reproduced from the Ordnance Survey map by BT

		100 May 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1	42 71417
KEY TO BT SYM	BOLS	Pole	0
DP	0	Planned Pole	0
Planned DP	•	30int Box	
PCP	ᡌ	Change Of State	+
Planned PCP	*	Split Coupling	×
Built	~	Duct Tee	
Planned		Planned Box	
Inferred	~	Manhole	
Building		Planned Manhole	
Klosk	€	Cabinet	Û
Hatchings	XX	Planned Cabinet	1
		Other proposed plant is shown using	ne dashad lines

87 Symbols not listed above maybe disregarded. Existing BT Plant may not be recorded. information valid at time of preparation

onenreach

BT Ref: YUU10472A



Information regarding the location of BT apparatus is given for your assistance and is intended for general guidance only. No guarantee is given of its accuracy.

It should not be relied upon in the event of excavations or other works being made near to BT apparatus which may exist at various depths and may deviate from the marked route.



openreach

CLICK BEFORE YOU DIG

FOR PROFESSIONAL FREE ON SITE ASSISTANCE PRIOR TO COMMENCEMENT OF EXCAVATION WORKS

email cbyd@openreach.co.uk

ADVANCE NOTICE REQUIRED (Office hours: Monday - Friday 08.00 to 17.00) www.spenreach.co.uk/sbyd

Reproduced from the Ordnance Survey map by BT by permission of Ordnance Survey on behalf of the Controller of Her Majesty's Stationary of the (C) Crown Copyright British Telecommunications

KEY TO BT SYM	BOLS	Pole	0
DP	0	Planned Pole	0
Planned DP	•	Joint Box	
PCP	ᡌ	Change Of State	+
Planned PCP	- 100	Split Coupling	×
Built	~	Duct Tee	
Planned		Planned Box	
Inferred	~	Manhole	
Building		Planned Manhole	
Klosk	(K)	Cabinet	Û
Hatchings	XXX	Planned Cabinet	0
		Other recovered plant in shown or	in a descript of these

openreach

Other proposed plant is shown using deshed lines BT Symbols not listed above maybe disregarded. Existing BT Plant may not be recorded. Information valid at time of oreographic

BT Ref: ZDW10486Q

Map Reference : (centre) SN50800004i Easting/Northing : (centre) 250800,20



nenrea

IMPORTANT WARNING

Information regarding the location of BT apparatus is given for your assistance and is intended for general guidance only.
No guarantee is given of its accuracy.
It should not be relied upon in the event of excavations or

other works being made near to BT apparatus which may exist at various depths and may deviate from the marked route





CLICK BEFORE YOU DIG
PROFESSIONAL FREE ON SITE ASSISTANCE PRIOR
TO COMMENCEMENT OF EXCAVATION WORKS
INCLUDING LOCATE AND MARKING SERVICE

email cbyd@openreach.co.uk

ADVANCE NOTICE REQUIRED (Office hours: Monday - Friday 08.00 to 17.00) www.openreach.co.uk/cbyd

Reproduced from the Ordnance Survey map by BT by permission of Ordnance Survey on Controller of Her Majesty's Station (C) Crown Copyright British Telecommunicati

KEY TO BT SYM	BOLS	Pole	0
DP	0	Planned Pole	0
Planned DP	•	Joint Box	
PCP	Ø	Change Of State	+
Planned PCP	1	Split Coupling	×
Built	~	Duct Tee	
Planned		Planned Box	4
Inferred	~	Manhole	
Building		Planned Manhole	
Klosk	(K)	Cabinet	
Hatchings	XXX	Planned Cabinet	17

Other proposed plant is shown using deshed lines. 8T Symbols not listed above maybe disregarded. Existing BT Plant may not be recorded. information valid at time of preparation

BT Ref: ZRA09193P

Map Reference: (centre) SN5050000500 Easting/Northing: (centre) 250500,200

Issued: 27/03/2017 09:20:26

VIRGIN MEDIA

